


LID SECURED
BY 2 NO. SCREWS



IMPORTANT :-
THE GROUP CONTROLLER'S POWER SUPPLIES COOLING RELIES ON NATURAL CONVECTION THROUGH THE CASE LOUVRES FOR CORRECT OPERATION THE POWER SUPPLY MUST BE MOUNTED AS SHOWN IN THIS INSTRUCTION, ALLOWING A MINIMUM FREE AIR CLEARANCE AROUND THE CASE OF 50mm

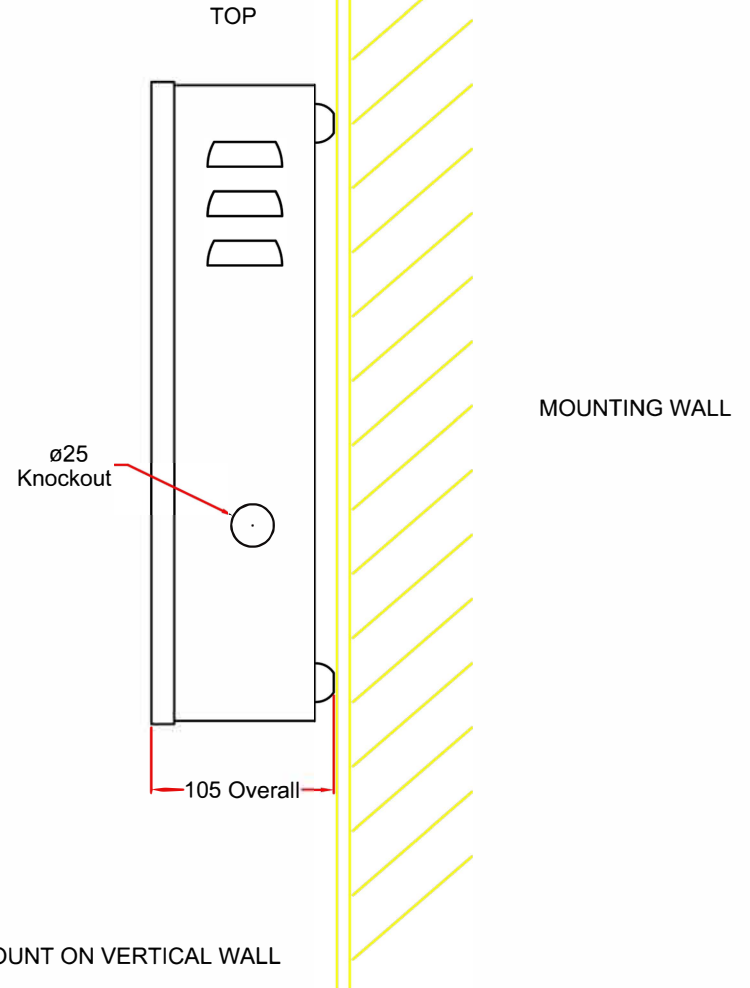